




Classified by
Underwriters Laboratories, Inc.
to UL 1479

System No. F-A-2410


ANSI/UL1479 (ASTM E814)
F Rating — 2 Hr
T Rating — 0 Hr

FA 2410

TOP VIEW

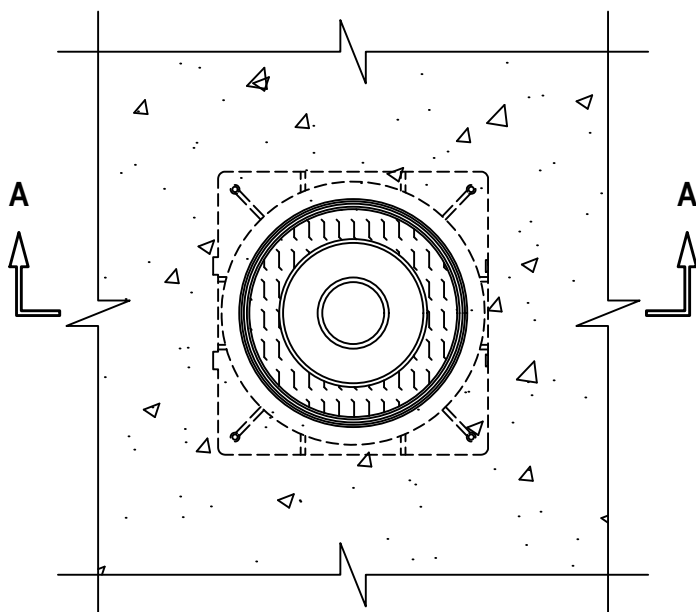

SECTION A-A

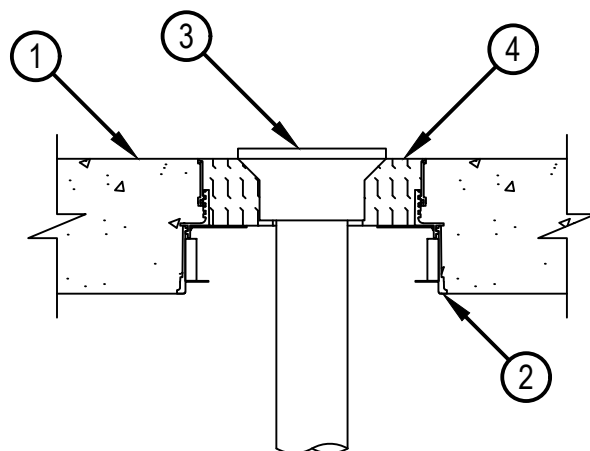

1. Floor Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete.
2. Firestop System — Firestop Device*—Cast in place firestop device with optional accessories including sleeve extensions permanently embedded during concrete placement or grouted in concrete assembly in accordance with accompanying installation instructions. Device to be cut flush with top surface of the concrete.
3. Drain Piping — Nom 2 in. (51 mm) diam Schedule 40 cellular or solid core polyvinyl chloride (PVC).
4. Shower Drain Fitting — Polyvinyl chloride (PVC) shower fitting sized to accommodate drain pipe.
5. Packing Material — Min 4 pcf (64 kg/m³) mineral wool batt insulation tightly packed into the device flush with the top surface of the floor. Packing material is optional when CFS-CID U2" or CFS-CID U 2" CA is employed for item 2.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

HILTI
Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
May 20, 2024