
UL/cUL SYSTEM NO. C-AJ-8209

MULTIPLE PENETRATING ITEMS THROUGH CONCRETE FLOOR/WALL OR BLOCK WALL

F-RATING = 3-HR.

T-RATING = 3/4-HR., 1-HR., 1 3/4-HR., OR 3-HR.

NOTE: TESTED WITH A 2.5 Pa PRESSURE DIFFERENTIAL

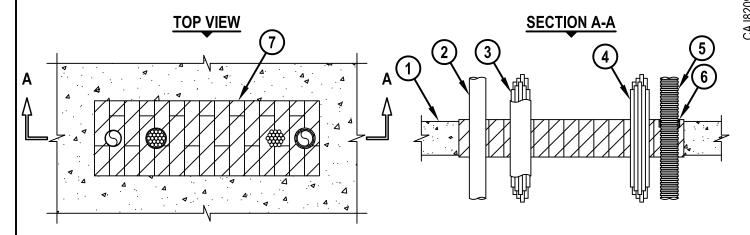

- 1. CONCRETE FLOOR OR WALL ASSEMBLY (3-HR. FIRE-RATING):
 - A. LIGHTWEIGHT OR NORMAL WEIGHT CONCRETE FLOOR OR WALL (MINIMUM 4-1/2" THICK).
 - B. ANY UL/cUL CLASSIFIED SOLID OR FILLED CONCRETE BLOCK WALL.
- 2. MAXIMUM 2" NOMINAL DIAMETER EMT OR STEEL CONDUIT.
- 3. MAXIMUM 1800 PAIR NO. 24 AWG ARMM TELEPHONE CABLE WITH PVC JACKET.
- 4. MAXIMUM 3" DIAMETER CABLE BUNDLE CONSISTING OF ANY OF THE FOLLOWING:
 - A. MAXIMUM 300 PAIR NO. 24 AWG TELEPHONE CABLE WITH PVC JACKET.
 - B. MAXIMUM 7/C NO. 12 AWG POWER CABLE WITH PVC JACKET.
 - C. MAXIMUM (24 FIBER) 1/2" DIAMETER FIBER-OPTIC CABLE.
- 5. MAXIMUM 2" NOMINAL DIAMETER PVC OPTICAL FIBER RACEWAY.
- 6. [OPTIONAL] HILTI CP 648E WRAP STRIP (NOMINAL 3/16" THICK x 1" WIDE) CONTINUOUSLY WRAPPED AROUND THE OUTER CIRCUMFERENCE OF THE RACEWAY, COVERING ONE TIME, AND HELD IN PLACE WITH TAPE. WRAP STRIP INSTALLED FLUSH WITH TOP SURFACE OF FIRESTOP BLOCKS.
- 7. HILTI CFS-BL FIRESTOP BLOCK (2" THICK x 8" WIDE x 5" DEEP, REFERENCE : TOP VIEW) FIRMLY PACKED AND CENTERED WITHIN OPENING.
 - NOTES: 1. MAXIMUM AREA OF OPENING = 300 SQ. IN., WITH A MAXIMUM DIMENSION OF 30".
 - 2. MINIMUM ANNULAR SPACE BETWEEN EMT, 1800 PAIR CABLE, FIBER OPTIC RACEWAYS, AND ADJACENT PENETRANTS = MINIMUM 3". MAXIMUM 12".
 - 3. MIN. ANNULAR SPACE BETWEEN CABLE BUNDLE AND ADJACENT PENETRANTS = 1-1/2".
 - 4. ANNULAR SPACE BETWEEN INDIVIDUAL PENETRANTS AND THE PERIPHERY OF THE OPENING = MINIMUM 1/2", MAXIMUM 11-1/4".
 - 5. APPLY HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT, CP 618 FIRESTOP PUTTY STICK, OR CP 620 FIRE FOAM IN ANY VOID THAT MAY EXIST (AROUND PENETRANTS OR BETWEEN FIRESTOP BLOCKS).



HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000

Sheet	1 of 1
Scale	5/64" = 1"
Date	Jan. 06, 2015

CAJ 8209b