


UL SYSTEM NO. F-A-3092
SINGLE TEK CABLE THROUGH CONCRETE FLOOR


F-RATING = 3-HR.
T-RATING = 1/2-HR.

FA3092a.091923

TOP VIEW

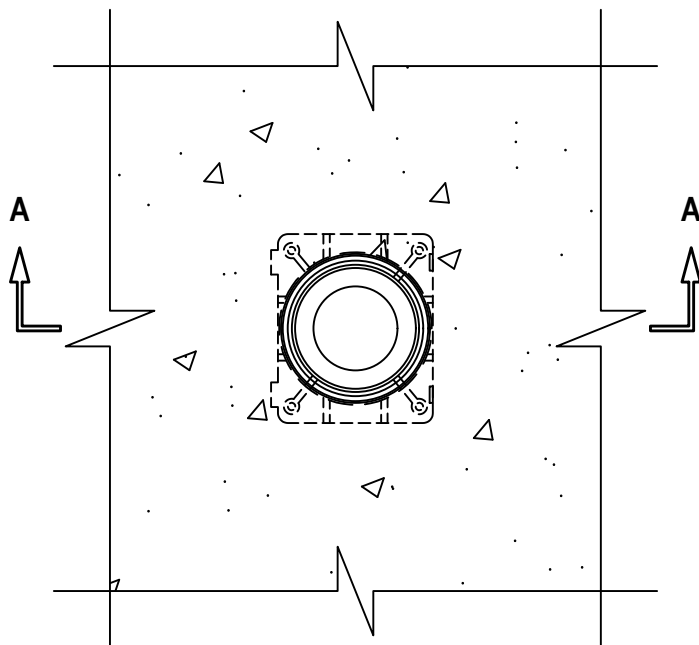

SECTION A-A

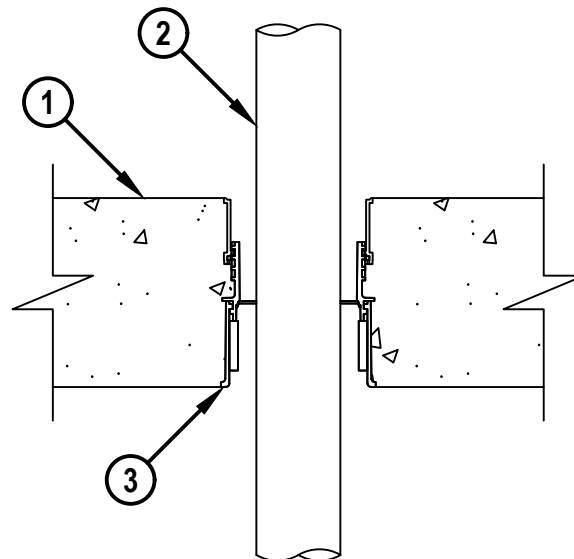

1. LIGHTWEIGHT OR NORMAL WEIGHT CONCRETE FLOOR (MINIMUM 4-1/2" THICK) (3-HR. FIRE-RATING).
2. NOMINAL 4/C 500 KCMIL COPPER CONDUCTOR PVC JACKETED ALUMINUM OR STEEL CLAD TEK CABLE.
3. HILTI CFS-CID U 2" OR CFS-CID U 2" CA CAST-IN FIRESTOP DEVICE CAST OR GROUTED INTO CONCRETE FLOOR.



Hilti Firestop Systems

HILTI, Inc.
Plano, Texas USA (800) 879-8000

Sheet	1 of 1
Scale	7/32" = 1"
Date	Sep. 19, 2023

Drawing No.

**FA
3092a**

Saving Lives through Innovation and Education