

RESIDENTIAL BUILDING			
Floor Substrate: Flat deck concrete slab			
SHEET	MEP PENETRATIONS THRU	SYSTEM	DESCRIPTION
4.1	FLOORS	F-A-1016	METAL PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-2012	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-2214	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-5015	METAL PIPE WITH AB/PVC INSULATION THROUGH CONCRETE FLOOR (2-HR)
		F-A-5017	METAL PIPE WITH GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2-HR)
		F-A-5045	METAL PIPE WITH AB/PVC OR GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2-HR)
		F-A-5046	METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)
4.2	FLOORS OR WALLS	C-A-J-1226	METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-1513	MULTIPLE METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-2035	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-2079	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-3095	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-3283	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-5090	METAL PIPE WITH AB/PVC INSULATION THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-5091	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-6042	ELECTRICAL BUSWAY THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-7051	METAL DUCT (WITHOUT DAMPER) THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-7084	ROUND SHEET METAL DUCT THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-7145	SHEET METAL DUCT WITH GLASS FIBER INSULATION THROUGH CONCRETE OR MASONRY (2-HR)
		C-A-J-8099	MULTIPLE METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)
C-A-J-8143	MULTIPLE PENETRATION THROUGH CONCRETE OR MASONRY (2-HR)		
4.3	GYPSUM WALLS	WL-1054	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-1389	MULTIPLE METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-3028	PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-2038	PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-9334	CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-3414	CABLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-5028	METAL PIPE WITH AB/PVC INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-5029	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-7042	METAL DUCT (WITHOUT DAMPER) THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-7155	METAL DUCT THROUGH GYPSUM WALL ASSEMBLY (2-HR)
		WL-7156	METAL DUCT WITH GLASS FIBER INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)
4.4	CONCRETE OR MASONRY WALL	W-J-3215	CABLE BUNDLE (1") (2-HR)
4.5	MEMBRANE PENETRATION	CLIV or CLIV-76	MEMBRANE PENETRATION IN GYPSUM WALL ASSEMBLY (2-HR)

SHEET	JOINTS	SYSTEM	DESCRIPTION
4.6	GYPSUM WALL	BW-S-0002	BOTTOM OF WALL JOINT (2-HR)
		HW-D-0106	TOP OF WALL JOINT (2-HR)
4.7	GYPSUM SHAFT WALL	HW-D-0209	TOP OF WALL JOINT (2-HR)
		HW-D-0757	TOP OF WALL JOINT (2-HR)
4.8	GYPSUM CHASE WALL	HW-D0342	TOP OF WALL JOINT (2-HR)
		HW-D0572	TOP OF WALL JOINT (2-HR)
4.9	CONCRETE OR MASONRY WALL	HW-D0758	TOP OF WALL JOINT: GYPSUM CHASE WALL ASSEMBLY (2-HR)
		HW-D-0268	TOP OF WALL JOINT: CONCRETE WALL OR BLOCK WALL ASSEMBLY (3-HR)
		HW-D-0403	TOP OF WALL JOINT: CONCRETE WALL OR BLOCK WALL ASSEMBLY (3-HR)

UL FIRE RESISTANCE DIRECTORY NOMENCLATURE

Through Penetrations			
First letter represents what is being penetrated	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: CAJ1150
F = FLOOR W = WALLS C = FLOORS OR WALLS (COMBINED)	A = CONCRETE FLOORS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 5 IN B = CONCRETE FLOORS WITH A MINIMUM THICKNESS GREATER THAN 5 IN C = FRAMED FLOORS E = FOR-CEILING ASSEMBLIES CONSISTING OF CONCRETE WITH MEMBRANE PROTECTION J = CONCRETE OR MASONRY WALLS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 8 IN L = FRAMED WALLS	0000 - 0999 BLANK OPENINGS 1000 - 1999 METAL PIPE, CONDUIT OR TUBING 2000 - 2999 NON METALLIC PIPE CONDUIT OR TUBING 3000 - 3999 CABLES 4000 - 4999 CABLE TRAYS 5000 - 5999 INSULATED PIPES 6000 - 6999 MISCELLANEOUS ELECTRICAL (BUSWAY) 7000 - 7999 MISCELLANEOUS MECHANICAL 8000 - 8999 MIXED PENETRATING ITEMS 9000 - 9999 RESERVED FOR FUTURE USE	C = FLOOR OR WALLPENETRATION A = CONCRETE FLOORS 5" OR LESS J = CONCRETE OR MASONRY WALLS 8" OR LESS 1150 = METAL PIPE, CONDUIT OR TUBING

Joint Systems			
First letters identify the type of joint:	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: HWD0757
CJ = CONTINUITY HEAD OF WALL FF = FLOOR TO FLOOR WW = WALL TO WALL FW = FLOOR TO WALL HW = HEAD TO WALL BW = BOTTOM OF WALL	S = NO MOVEMENT (STATIC) D = ALLOWS MOVEMENT (DYNAMIC)	0000 - 0999 LESS THAN OR EQUAL TO 2" 1000 - 1999 GREATER THAN 2" AND LESS THAN OR EQUAL TO 6" 2000 - 2999 GREATER THAN 6" AND LESS THAN OR EQUAL TO 12" 3000 - 3999 GREATER THAN 12" AND LESS THAN OR EQUAL TO 24" 4000 - 4999 GREATER THAN 24"	HW = HEAD TO WALL D = ALLOWS MOVEMENT (DYNAMIC) 0757 = LESS THAN OR EQUAL TO 2"

Notes:

- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - 22 00 00 Plumbing
 - 23 00 00 HVAC
 - 26 00 00 Electrical
 - 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 06-13-2018

REVISIONS: _____

SHEET NAME: _____
Index of Drawings

SHEET NUMBER: _____

System No. W-J-3215		
ANSI/A 1479 (ASTM E814)	CANULC 5115	F Rating — 2 H
T Rating — 1/2 H (See Item 2)	FT Rating — 1/2 and 2 H (See Item 2)	FT Rating — 2 H
L Rating at Ambient — Less than 1 CFM/Opening	FTH Rating — 2 H	FTH Rating — 2 H
L Rating at 400 F — Less than 1 CFM/Opening	FTH Rating — 1/2 and 2 H (See Item 2)	L Rating at Ambient — Less than 1 CFM/Opening
		L Rating at 400 F — Less than 1 CFM/Opening

System No. W-J-3215		
1. Wall Assembly — Min 6 in. (152 mm) thick lightweight or normal weight (105-150 pcf or 1600-2400 kg/m ³) concrete. Wall may also be constructed of any UL Classified Concrete Block*. Opening may be round, rectangular or irregular with a max diam or dimension of 1 in. (25 mm).		
2. See Concrete Block (CB) category in the Fire Resistance Directory for names of manufacturers.		
3. Cable — Single or split bundle of cables to be installed within the opening. Aggregate cross-sectional area of cables in opening to have a total fill of min 75% to max 100%. The annular space between the cable bundle and the periphery of the opening to be min 0.1 in. (joint contact). Cables to be rigidly supported on both sides of the wall assembly. Any combination of the following types and sizes of cables may be used:		
A. Max 3C No. 8 AWG/3M copper conductor cable (Belden) with PVC insulation and jacket.		
B. Max 12C No. 12 AWG/3M copper conductor control cable with PVC or PE insulation and jacket.		
C. Max 10C No. 16 AWG/3M copper conductor telecommunication cable with PVC or aluminum rated insulation and jacketing.		
D. Max 24 No. 22 AWG/3M copper conductor cable with PVC or aluminum rated insulation and jacketing.		
E. 1/2 in. (12.7 mm) diameter cable with EMI/RFI shield or PVC insulation and jacketing having a max. outside diameter of 1/2 in. (12.7 mm).		
F. Max 24 fiber optic cable with polyimide (PVC) or polyethylene (PE) jacket and insulation.		
G. 1/2 in. (12.7 mm) diameter cable with EMI/RFI shield or PVC insulation and jacketing having a max. outside diameter of 1/2 in. (12.7 mm).		
H. Maximum 3C No. 10 AWG shielded cable.		
* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.		

Notes:

1. Refer to the following specifications for firestopping.
 - a. 07 84 00 Firestopping
 - b. 07 84 13 Penetration Firestopping
 - c. 07 84 43 Joints Firestopping
 - d. 22 00 00 Plumbing
 - e. 23 00 00 HVAC
 - f. 26 00 00 Electrical
 - g. 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

2. Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

4. References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

6. All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: _____

DRAWN: _____






CHECKED: _____

ISSUE DATE: 06-13-2018

REVISIONS: _____

SHEET NAME:
 Residential - Flat Deck Concrete or Masonry-Walls

SHEET NUMBER: _____

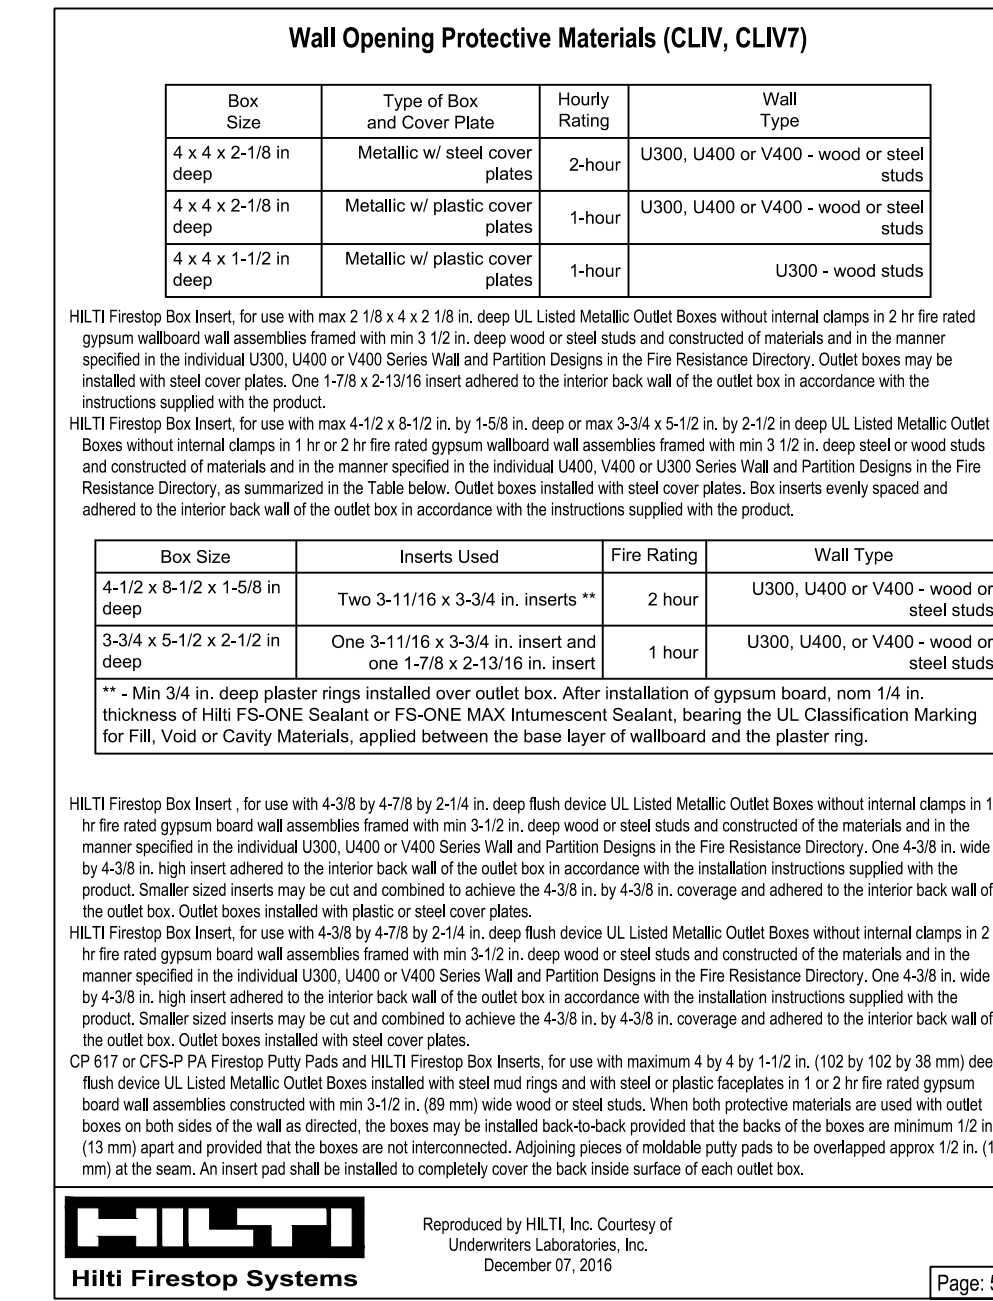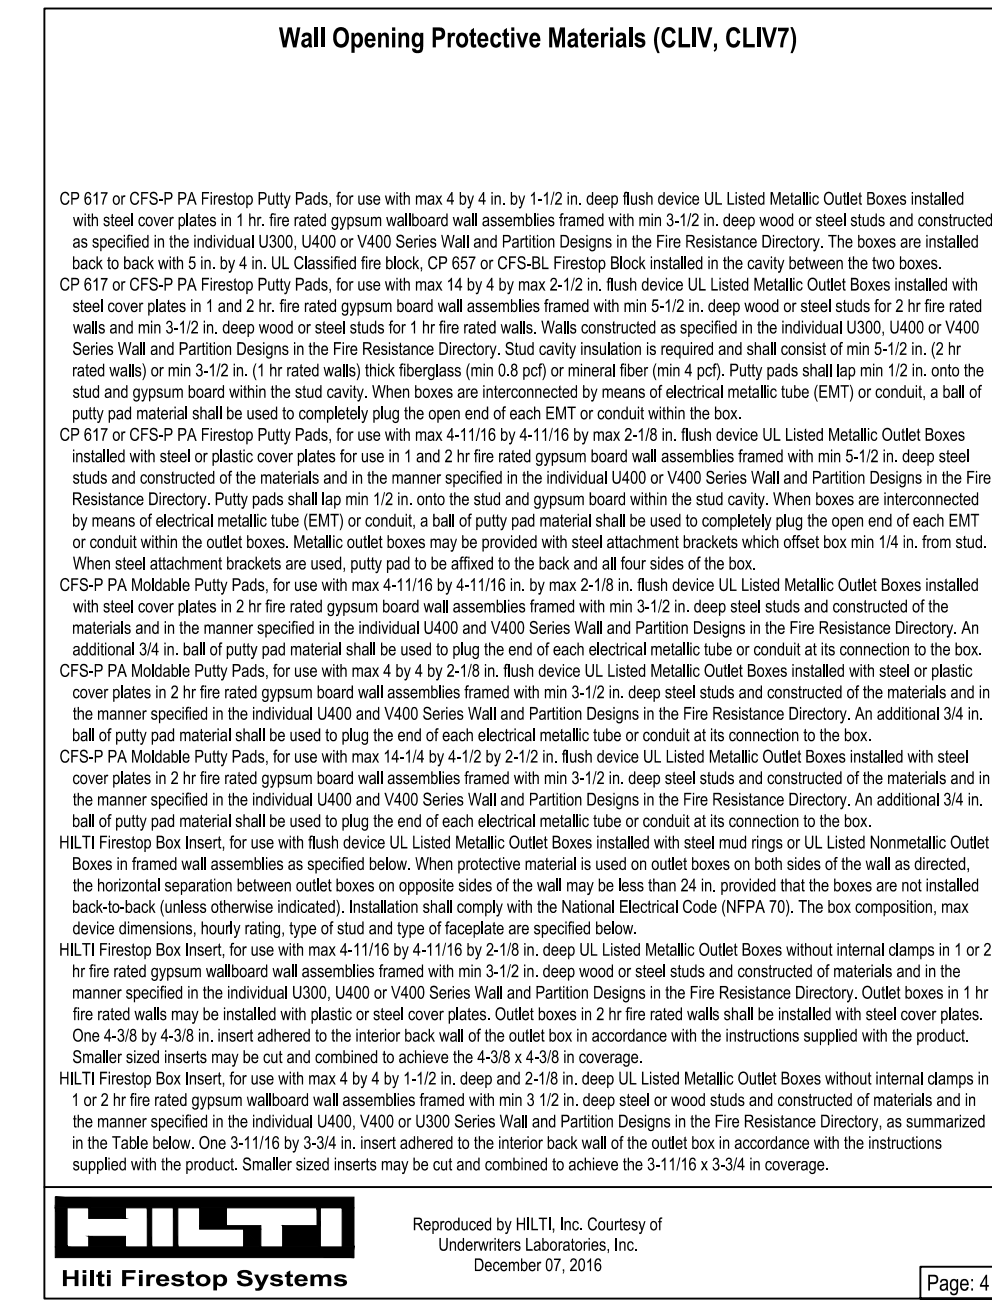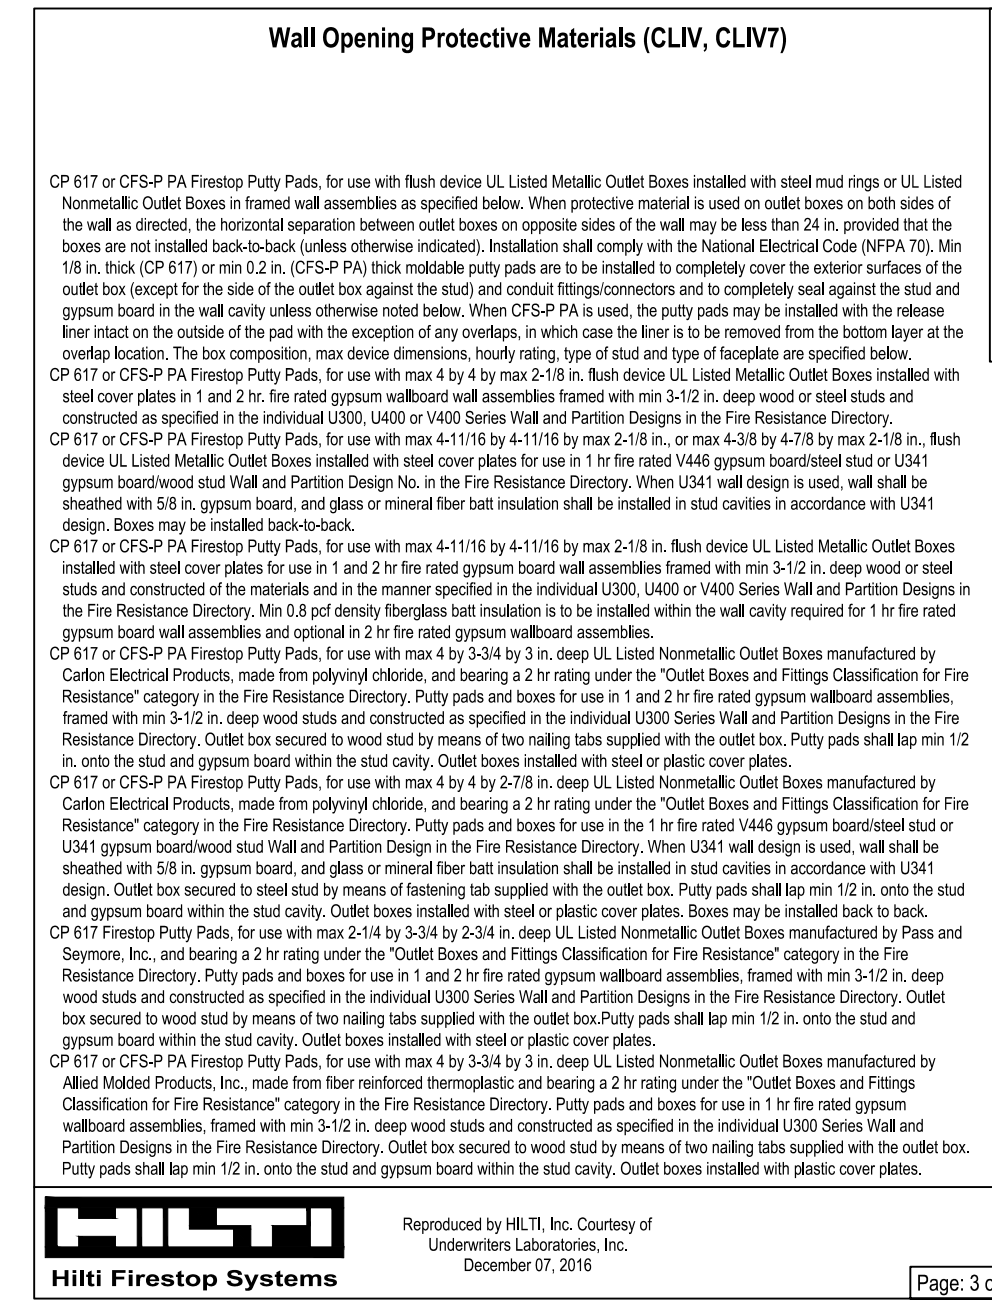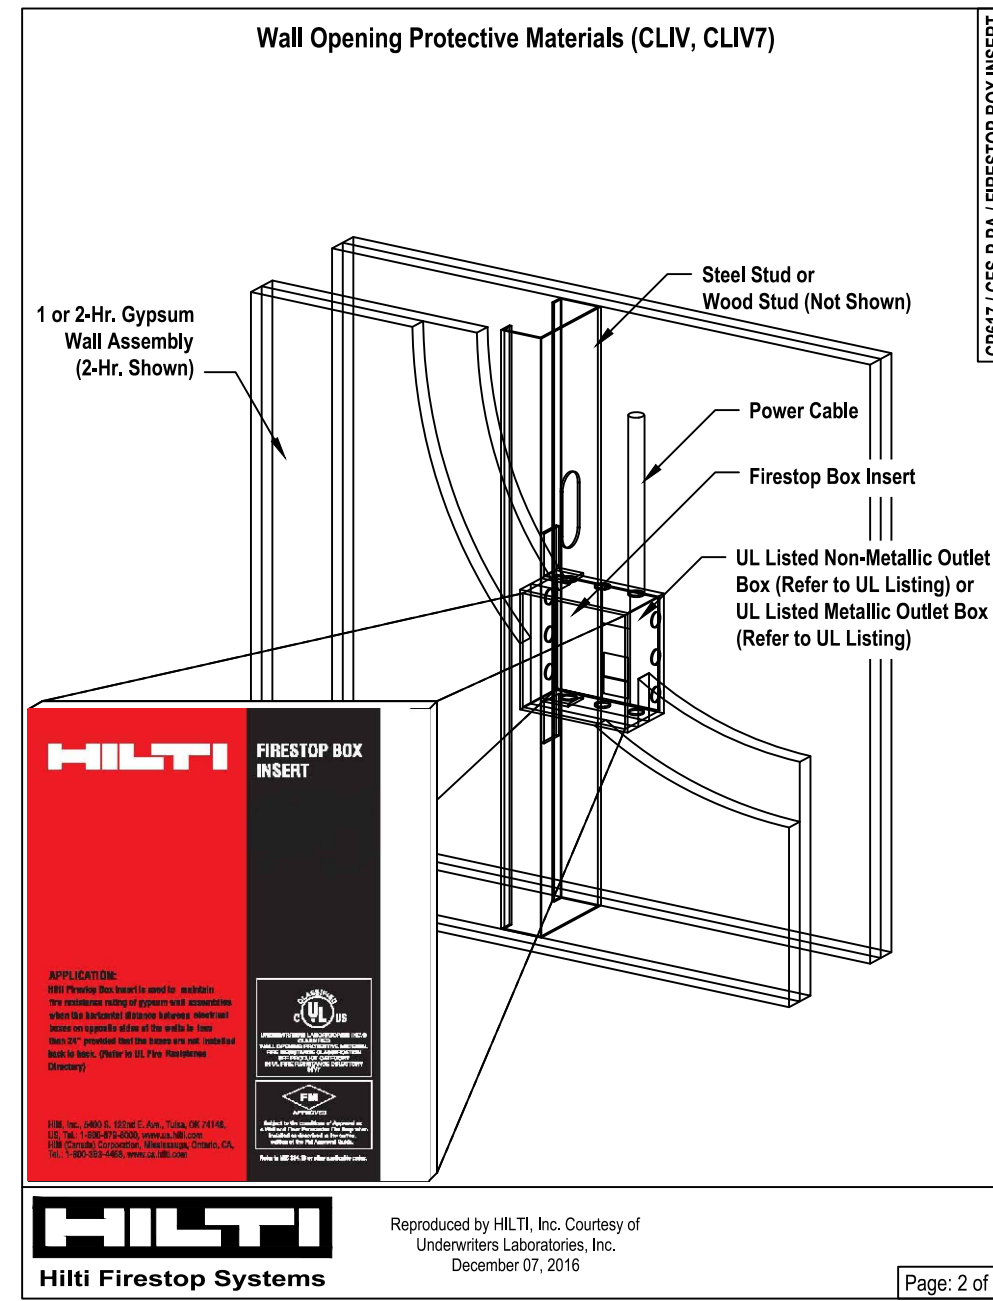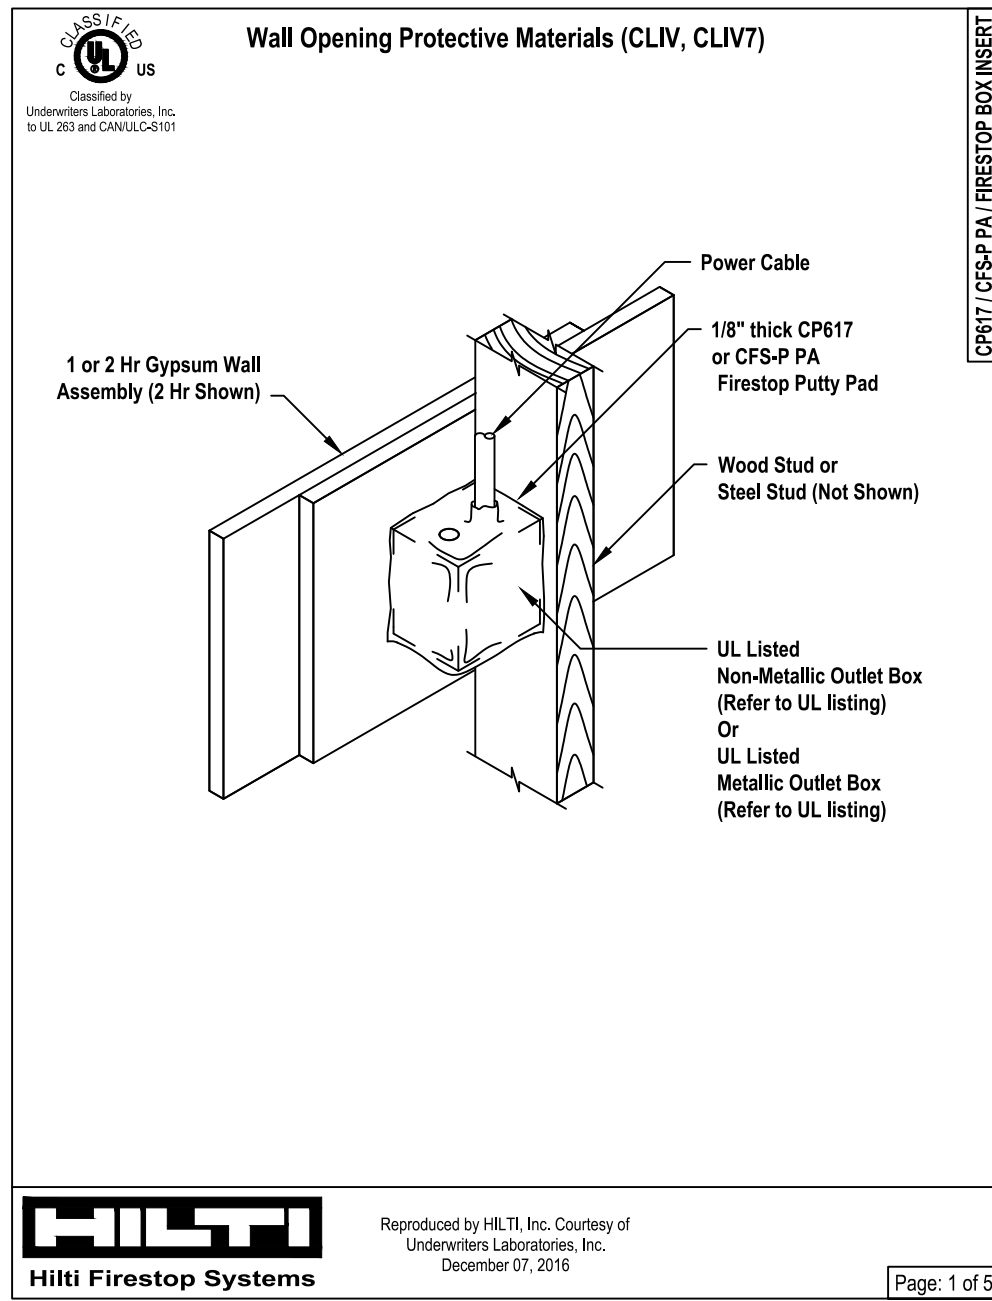

Notes:

- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - 22 00 00 Plumbing
 - 23 00 00 HVAC
 - 26 00 00 Electrical
 - 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriters Laboratories Fire Resistance Directory (volume 2)'.

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 06-13-2018

REVISIONS: _____

SHEET NAME: Residential - Flat Deck Membrane-Penetration

SHEET NUMBER: _____

System No. BW-S-0002	ANSI/AISI 209 Assembly Ratings — 1 and 2 Hr (See Item 2)	CANULC 5115 F Ratings — 1 and 2 Hr (See Item 1)
Normal Joint Width — 3/4 in.	FT Ratings — 1 and 2 Hr (See Item 1)	
L Rating at Ambient — Less Than 1 CFM/Lin Ft	PH Ratings — 1 and 2 Hr (See Item 1)	
L Rating at 400° F — Less Than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 1)	
	Normal Joint Width — 3/4 in.	
	L Rating at Ambient — Less Than 1 CFM/Lin Ft	
	L Rating at 400° F — Less Than 1 CFM/Lin Ft	

1. Floor Assembly — Min. 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified Hollowcore Precast Concrete Units*. See Precast Concrete Units category in the Fire Resistance Directory for names of manufacturers.

2. Wall Assembly — The 1 or 2 hr rated gypsum board shall not be constructed of the materials and in the manner specified in the individual UL607 or W400 Series Wall and Partition Design in the U.L. Fire Resistance Directory and shall include the following construction features:

A. Steel Floor and Ceiling Runners — Floor runners of wall assembly shall consist of min. No. 25 gauge galv. steel channels sized to accommodate steel studs (Item 2B). Floor runners for ceilings with 1-1/2 in. (38 mm) depth. Runners with attachment to wall runners spaced 12 in. (305 mm) OC.

B. Studs — Stud studs to be min. 3-1/2 in. (89 mm) wide. Studs set in 3/4 in. (19 mm) hole in length than assembly height with bottom flange in, ready on and lapped to floor runner with steel metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Gypsum Board — Gypsum board to be 5/8 in. (16 mm) thick. Gypsum board to be 5/8 in. (16 mm) thick in all areas for a 1 or 2 hr wall, respectively. Wall to be constructed as specified in the individual UL607 or W400 Series Design in the U.L. Fire Resistance Directory.

3. Fire Rated Ceiling Material — 1/2 in. (13 mm) gypsum board or 5/8 in. (16 mm) gypsum board shall be installed on top of the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly.

Hilti Firestop Systems

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. February 20, 2013

Page 2 of 2

System No. HW-D-0106	ANSI/AISI 209 Assembly Ratings — 1 and 2 Hr (See Items 2 and 3)	CANULC 5115 F Ratings — 1 and 2 Hr (See Item 2)
Normal Joint Width — 3/4 in.	FT Ratings — 1 and 2 Hr (See Item 2)	
L Rating at Ambient — Less Than 1 CFM/Lin Ft	PH Ratings — 1 and 2 Hr (See Item 2)	
L Rating at 400° F — Less Than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 2)	

1. Floor Assembly — Min. 4-1/2 in. (114 mm) thick steel-reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified Hollowcore Precast Concrete Units*.

2. Wall Assembly — The 1 or 2 hr rated gypsum board shall not be constructed of the materials and in the manner specified in the individual UL607 or W400 Series Wall and Partition Design in the U.L. Fire Resistance Directory. In addition, the wall may incorporate the following construction features:

A. Steel Floor and Ceiling Runners — Floor and ceiling runners of wall assembly shall consist of min. No. 25 gauge galv. steel channels sized to accommodate steel studs (Item 2B). Floor runners for ceilings with 1-1/2 in. (38 mm) depth. Runners with attachment to wall runners spaced 12 in. (305 mm) OC.

B. Studs — Stud studs to be min. 3-1/2 in. (89 mm) wide. Studs set in 3/4 in. (19 mm) hole in length than assembly height with bottom flange in, ready on and lapped to floor runner with steel metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Gypsum Board — Gypsum board to be 5/8 in. (16 mm) thick. Gypsum board to be 5/8 in. (16 mm) thick in all areas for a 1 or 2 hr wall, respectively. Wall to be constructed as specified in the individual UL607 or W400 Series Design in the U.L. Fire Resistance Directory.

3. Fire Rated Ceiling Material — 1/2 in. (13 mm) gypsum board or 5/8 in. (16 mm) gypsum board shall be installed on top of the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly.

Hilti Firestop Systems

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 20, 2013

Page 2 of 2

System No. HW-D-0209	ANSI/AISI 209 Assembly Ratings — 1 and 2 Hr (See Item 2)	CANULC 5115 F Ratings — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 in.	FT Ratings — 1 and 2 Hr (See Item 2)	
L Rating at Ambient — Less Than 1 CFM/Lin Ft	PH Ratings — 1 and 2 Hr (See Item 2)	
L Rating at 400° F — Less Than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 2)	

1. Floor Assembly — Min. 4-1/2 in. (114 mm) thick steel-reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified Hollowcore Precast Concrete Units*.

2. Wall Assembly — The 1 or 2 hr rated gypsum board shall not be constructed of the materials and in the manner specified in the individual UL607 or W400 Series Wall and Partition Design in the U.L. Fire Resistance Directory and shall include the following construction features:

A. Steel Floor and Ceiling Runners — Floor and ceiling runners of wall assembly shall consist of min. No. 25 gauge galv. steel channels sized to accommodate steel studs (Item 2B). Floor runners for ceilings with 1-1/2 in. (38 mm) depth. Runners with attachment to wall runners spaced 12 in. (305 mm) OC.

B. Studs — Stud studs to be min. 3-1/2 in. (89 mm) wide. Studs set in 3/4 in. (19 mm) hole in length than assembly height with bottom flange in, ready on and lapped to floor runner with steel metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Gypsum Board — Gypsum board to be 5/8 in. (16 mm) thick. Gypsum board to be 5/8 in. (16 mm) thick in all areas for a 1 or 2 hr wall, respectively. Wall to be constructed as specified in the individual UL607 or W400 Series Design in the U.L. Fire Resistance Directory.

3. Fire Rated Ceiling Material — 1/2 in. (13 mm) gypsum board or 5/8 in. (16 mm) gypsum board shall be installed on top of the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly.

Hilti Firestop Systems

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 20, 2013

Page 2 of 2

System No. HW-D-0209	ANSI/AISI 209 Assembly Ratings — 1 and 2 Hr (See Item 2)	CANULC 5115 F Ratings — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 in.	FT Ratings — 1 and 2 Hr (See Item 2)	
L Rating at Ambient — Less Than 1 CFM/Lin Ft	PH Ratings — 1 and 2 Hr (See Item 2)	
L Rating at 400° F — Less Than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 2)	

1. Floor Assembly — Min. 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified Hollowcore Precast Concrete Units*.

2. Wall Assembly — The 1 or 2 hr rated gypsum board shall not be constructed of the materials and in the manner specified in the individual UL607 or W400 Series Wall and Partition Design in the U.L. Fire Resistance Directory and shall include the following construction features:

A. Steel Floor and Ceiling Runners — Floor and ceiling runners of wall assembly shall consist of min. No. 25 gauge galv. steel channels sized to accommodate steel studs (Item 2B). Floor runners for ceilings with 1-1/2 in. (38 mm) depth. Runners with attachment to wall runners spaced 12 in. (305 mm) OC.

B. Studs — Stud studs to be min. 3-1/2 in. (89 mm) wide. Studs set in 3/4 in. (19 mm) hole in length than assembly height with bottom flange in, ready on and lapped to floor runner with steel metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Gypsum Board — Gypsum board to be 5/8 in. (16 mm) thick. Gypsum board to be 5/8 in. (16 mm) thick in all areas for a 1 or 2 hr wall, respectively. Wall to be constructed as specified in the individual UL607 or W400 Series Design in the U.L. Fire Resistance Directory.

3. Fire Rated Ceiling Material — 1/2 in. (13 mm) gypsum board or 5/8 in. (16 mm) gypsum board shall be installed on top of the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly.

Hilti Firestop Systems

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. February 20, 2013

Page 2 of 2

System No. HW-D-0209	ANSI/AISI 209 Assembly Ratings — 1 and 2 Hr (See Item 2)	CANULC 5115 F Ratings — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 in.	FT Ratings — 1 and 2 Hr (See Item 2)	
L Rating at Ambient — Less Than 1 CFM/Lin Ft	PH Ratings — 1 and 2 Hr (See Item 2)	
L Rating at 400° F — Less Than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 2)	

1. Floor Assembly — Min. 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified Hollowcore Precast Concrete Units*.

2. Wall Assembly — The 1 or 2 hr rated gypsum board shall not be constructed of the materials and in the manner specified in the individual UL607 or W400 Series Wall and Partition Design in the U.L. Fire Resistance Directory and shall include the following construction features:

A. Steel Floor and Ceiling Runners — Floor and ceiling runners of wall assembly shall consist of min. No. 25 gauge galv. steel channels sized to accommodate steel studs (Item 2B). Floor runners for ceilings with 1-1/2 in. (38 mm) depth. Runners with attachment to wall runners spaced 12 in. (305 mm) OC.

B. Studs — Stud studs to be min. 3-1/2 in. (89 mm) wide. Studs set in 3/4 in. (19 mm) hole in length than assembly height with bottom flange in, ready on and lapped to floor runner with steel metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Gypsum Board — Gypsum board to be 5/8 in. (16 mm) thick. Gypsum board to be 5/8 in. (16 mm) thick in all areas for a 1 or 2 hr wall, respectively. Wall to be constructed as specified in the individual UL607 or W400 Series Design in the U.L. Fire Resistance Directory.

3. Fire Rated Ceiling Material — 1/2 in. (13 mm) gypsum board or 5/8 in. (16 mm) gypsum board shall be installed on top of the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly.

Hilti Firestop Systems

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. February 20, 2013

Page 2 of 2

System No. HW-D-0757	ANSI/AISI 209 Assembly Ratings — 1 and 2 Hr (See Item 2)	CANULC 5115 F Ratings — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/8 in.	FT Ratings — 1 and 2 Hr (See Item 2)	
L Rating at Ambient — Less Than 1 CFM/Lin Ft	PH Ratings — 1 and 2 Hr (See Item 2)	
L Rating at 400° F — Less Than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 2)	

1. Floor Assembly — Min. 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified Hollowcore Precast Concrete Units*.

2. Wall Assembly — The 1 or 2 hr rated gypsum board shall not be constructed of the materials and in the manner specified in the individual UL607 or W400 Series Wall and Partition Design in the U.L. Fire Resistance Directory and shall include the following construction features:

A. Steel Floor and Ceiling Runners — Floor and ceiling runners of wall assembly shall consist of min. No. 25 gauge galv. steel channels sized to accommodate steel studs (Item 2B). Floor runners for ceilings with 1-1/2 in. (38 mm) depth. Runners with attachment to wall runners spaced 12 in. (305 mm) OC.

B. Studs — Stud studs to be min. 3-1/2 in. (89 mm) wide. Studs set in 3/4 in. (19 mm) hole in length than assembly height with bottom flange in, ready on and lapped to floor runner with steel metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Gypsum Board — Gypsum board to be 5/8 in. (16 mm) thick. Gypsum board to be 5/8 in. (16 mm) thick in all areas for a 1 or 2 hr wall, respectively. Wall to be constructed as specified in the individual UL607 or W400 Series Design in the U.L. Fire Resistance Directory.

3. Fire Rated Ceiling Material — 1/2 in. (13 mm) gypsum board or 5/8 in. (16 mm) gypsum board shall be installed on top of the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly.

Hilti Firestop Systems

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. December 20, 2013

Page 1 of 2

System No. HW-D-0757	ANSI/AISI 209 Assembly Ratings — 1 and 2 Hr (See Item 2)	CANULC 5115 F Ratings — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/8 in.	FT Ratings — 1 and 2 Hr (See Item 2)	
L Rating at Ambient — Less Than 1 CFM/Lin Ft	PH Ratings — 1 and 2 Hr (See Item 2)	
L Rating at 400° F — Less Than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 2)	

1. Floor Assembly — Min. 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified Hollowcore Precast Concrete Units*.

2. Wall Assembly — The 1 or 2 hr rated gypsum board shall not be constructed of the materials and in the manner specified in the individual UL607 or W400 Series Wall and Partition Design in the U.L. Fire Resistance Directory and shall include the following construction features:

A. Steel Floor and Ceiling Runners — Floor and ceiling runners of wall assembly shall consist of min. No. 25 gauge galv. steel channels sized to accommodate steel studs (Item 2B). Floor runners for ceilings with 1-1/2 in. (38 mm) depth. Runners with attachment to wall runners spaced 12 in. (305 mm) OC.

B. Studs — Stud studs to be min. 3-1/2 in. (89 mm) wide. Studs set in 3/4 in. (19 mm) hole in length than assembly height with bottom flange in, ready on and lapped to floor runner with steel metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Gypsum Board — Gypsum board to be 5/8 in. (16 mm) thick. Gypsum board to be 5/8 in. (16 mm) thick in all areas for a 1 or 2 hr wall, respectively. Wall to be constructed as specified in the individual UL607 or W400 Series Design in the U.L. Fire Resistance Directory.

3. Fire Rated Ceiling Material — 1/2 in. (13 mm) gypsum board or 5/8 in. (16 mm) gypsum board shall be installed on top of the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly. Runners shall be attached to the gypsum board and bottom of the floor assembly.

Hilti Firestop Systems

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. December 20, 2013

Page 2 of 2

- Notes:
- Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
 - Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Minimum and maximum Width of Joists
 - * Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
 - * If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
 - References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 - * Intertek Directory of Building Products
 - * All governing local and regional building codes

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current "Underwriters Laboratories Fire Resistance Directory (volume 2)"

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 06-13-2018

REVISIONS: _____

SHEET NAME: Residential - Flat Deck Joints-Gypsum-Walls

SHEET NUMBER: _____

System No. HW-D-0342

ANSI/UL2079	CANULC S115
Assembly Rating — 2 Hr	F Rating — 2 Hr
Normal Joint Width — 1 in.	FT Rating — 2 Hr
Class II Movement Capabilities — 0% Compression and Extension	FTI Rating — 2 Hr
L Rating Ambient — Less Than 1 CFM/hr	FTI Rating — 2 Hr
L Rating At 400 F — Less Than 1 CFM/hr	Normal Joint Width — 1 in.
	Class II Movement Capabilities — 0% Compression and Extension
	L Rating Ambient — Less Than 1 CFM/hr
	L Rating At 400 F — Less Than 1 CFM/hr

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2015. Page: 1 of 2

System No. HW-D-0342

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2015. Page: 2 of 2

System No. HW-D-0572

ANSI/UL2079	CANULC S115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1-1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTI Rating — 1 and 2 Hr (See Item 2)
	Normal Joint Width — 1-1/2 in.
	Class II Movement Capabilities — 50% Compression and Extension

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 21, 2015. Page: 1 of 2

System No. HW-D-0572

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 21, 2015. Page: 2 of 2

System No. HW-D-0572

1. Floor Assembly — Min. 2-1/2 in. (64 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete.

2. Slab Reinforcement — The 2 in. (51 mm) diameter gypsum board steel stud shall be assembly shall be constructed of the materials and in the manner described in the individual UL90, V400 or V800 Series Wall and Partition Design in the UL Fire Resistance Directory and shall include the following construction features:

A. Floor and Ceiling Runners — J-shaped runner, 2-1/2 in. (64 mm) wide with unequal legs of min. 1-1/4 in. (32 mm) and 2 in. (51 mm), fabricated from 24 MSG galv. steel. Runners positioned with steel legs toward finished side of wall. Runners attached to structural supports with steel fasteners located not greater than 24 in. (61 mm) from ends and not greater than 24 in. (61 mm) OC.

B. Light Gauge Framing — "Double C"ing Track — Cold-formed galvanized steel track shall consist of galv. steel channels with adiabatic flanges. Slotted ceiling track used to accommodate steel "C" shaped studs (Item 2C). Attached to concrete of ceiling with steel fasteners spaced max. 24 in. (61 mm) OC.

C. CALIFORNIA EXPANDED METAL PRODUCTS CO. — CEF

EMERY CONSTRUCTION INDUSTRIES INC. DSA RAFTTRACK SYSTEMS — SLR-TRK

MARPOWALE, DIV. OF INHARE INDUSTRIES INC. — Type SLT

81. Light Gauge Framing Members — Cold-formed Sheet: In the assembly, the steel studs (Item 2C) may incorporate vertical deflection clips for attachment to the ceiling runner (Item 2A) in accordance with the manufacturer's instructions.

THE STEEL METWORKS INC. — WAC/CS S13-150

C. Steel Studs — C-shaped studs, 2-1/2 in. (64 mm) wide by 1-1/2 in. (38 mm) deep, fabricated from min. 20 MSG galv. steel, cut to lengths 24 in. (61 mm) from floor to ceiling height and spaced 24 in. (61 mm) OC. Studs used in floor runner or bottom and a runner on adiabatic ceiling track at top. After installation of gypsum board (Item 2D), studs secured to flange of floor runner on finished side of wall with the 1/4 in. (6 mm) long self-drilling wall-slagging wall stud steel screws as per manufacturer's instructions. Studs secured to flange of ceiling track on finished side of wall with the 3/8 in. (9.5 mm) long self-drilling wall-slagging wall stud steel screws as per manufacturer's instructions. Studs secured to flange of ceiling track on finished side of wall with the 3/8 in. (9.5 mm) long self-drilling wall-slagging wall stud steel screws as per manufacturer's instructions.

D. Gypsum Board — Item 2A in (125 mm) thick gypsum board applied vertically in one or two layers for 1 hr and 2 hr rated assemblies, respectively. Panels cut 1/2 in. (13 mm) less in length than floor to ceiling height. Vertical edges mounted in "Y" shaped section of "C" shaped studs at the ends of the assembly. The free edge of the end panels are finished to the top edge of vertical runners (Item 2B) with 1/8 in. (3 mm) long Type 5 steel screws spaced max. 12 in. (305 mm) OC.

E. Gypsum Board — Gypsum board sheets, 1/2 in. (12.5 mm) thick, applied vertically in two layers on finished side of wall as specified in the individual UL90 or V400 Series design. A max. 1 in. (25 mm) gap shall be maintained between the top of the gypsum board and the bottom surface of the concrete floor. The screws attaching the gypsum board layers to the "C" shaped studs shall be spaced 1 in. (25 mm) below the bottom of the runner or adiabatic ceiling track. No gypsum board attachment screws are to penetrate the ceiling runner and adiabatic ceiling track.

3. Joint System — Max. separation between top of floor panel (Item 2D) and bottom top of gypsum board sheets (Item 2E) at line of installation of joint system is 1 in. (25 mm). The joint system is designed to accommodate a maximum panel compression and extension from its installed width. The joint system consists of the following:

A. "B" Stud or Chalk Headset — Stud — Min. 1 in. (25 mm) depth of stud to be installed to fill three gap between top of gypsum board floor panel (Item 2D) and top inside surface of ceiling runner or adiabatic ceiling track prior to installation of gypsum board sheets (Item 2E) on finished side of wall. Min. 1 in. (25 mm) depth of stud to be installed to fill three gap between top of gypsum board sheets (Item 2E) and bottom of concrete floor.

H.E.T.I. CONSTRUCTION CHEMICALS, DIV. OF H.E.T.I. INC. — CP-050

*Reering the U.L. Classification Mark.

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 21, 2015. Page: 1 of 2

System No. HW-D-0572

1. Floor Assembly — Min. 2-1/2 in. (64 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also consist of any 8 in. (203 mm) thick U.L. Classified Hollow-core Precast Concrete Slab.*

See Physical Consideration (C&T) category in the Fire Resistance Directory for details of construction.

2. Slab Reinforcement — The 2 in. (51 mm) diameter gypsum board steel stud shall be assembly shall be constructed of the materials and in the manner described in the individual UL90, V400 or V800 Series Wall and Partition Design in the UL Fire Resistance Directory and shall include the following construction features:

A. Floor and Ceiling Runners — J-shaped runner, steel equal in width to steel studs (Item 2C) with unequal legs of 1 in. (25 mm) and 2 in. (51 mm), fabricated from 24 MSG galv. steel. Runners positioned with steel legs toward finished side of wall. Runners attached to floor with steel fasteners located not greater than 1 in. (25 mm) from ends and not greater than 24 in. (61 mm) OC.

B. Ceiling Runner — Ceiling runner shall consist of galv. steel channel used to accommodate steel studs (Item 2C). Flange height of ceiling runner shall not exceed 1-1/2 in. (38 mm) greater than max. channel joint width. Ceiling runner secured with steel fasteners located not more than 2 in. (51 mm) from ends and spaced not greater than 24 in. (61 mm) OC.

H.E.T.I. CONSTRUCTION CHEMICALS, DIV. OF H.E.T.I. INC. — CP-071 Firestop Spray or CFS-SP VBS Firestop Joint Spray

*Indicates such products shall bear the U.L. or UL Certification Mark for jurisdictions enabling the U.L. or UL Certification (such as Canada), respectively.

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 21, 2015. Page: 2 of 2

System No. HW-D-0572

81. Light Gauge Framing — "Double C"ing Runner — As an alternate to the ceiling runner in Item 2B, adiabatic ceiling runner to consist of galv. steel channel with adiabatic flanges used to accommodate steel studs (Item 2C). Flange height of adiabatic ceiling runner shall be min. 1 1/4 in. (30 mm) greater than max. channel joint width. Slotted ceiling runner secured with steel fasteners located not more than 2 in. (51 mm) from ends and spaced max. 24 in. (61 mm) OC.

EMERY CONSTRUCTION INDUSTRIES INC. DSA RAFTTRACK SYSTEMS — SLR-TRK

CALIFORNIA EXPANDED METAL PRODUCTS CO. — CEF

CLARKBROOK BUILDING SYSTEMS — Type SLT SLT-4

MARPOWALE, DIV. OF INHARE INDUSTRIES INC. — Type SLT

METALITE INC. — The System

SCAFCO STEEL STUD MANUFACTURING CO. — Slotted Track

THE STEEL METWORKS INC. — WAC/CS S13-150

C. Steel Studs — C-shaped studs, min. 2 in. (51 mm) wide by 1-1/2 in. (38 mm) deep, fabricated from 20 MSG galv. steel, cut to lengths 34 in. (863 mm) from floor to ceiling height and spaced 24 in. (61 mm) OC.

D. Gypsum Board — Item 1 in. (25 mm) thick gypsum board floor panels, Panels cut 1/2 in. (13 mm) less in length than floor to ceiling height. Vertical edges mounted in notched section of "C" shaped studs. At the ends of the end panels the free edge of the end panels are attached to the flange of vertical runners (Item 2A) with 1/8 in. (3 mm) long Type 5 steel screws spaced max. 12 in. (305 mm) OC.

E. Gypsum Board — Item 1/2 in. (12.5 mm) thick gypsum board applied vertically in one or two layers for 1 hr and 2 hr rated assemblies, respectively. Panels cut 1/2 in. (13 mm) less in length than floor to ceiling height. The screws attaching the gypsum board layers to the "C" shaped studs shall be spaced 1 in. (25 mm) below the bottom of the ceiling runner or adiabatic ceiling track. No gypsum board attachment screws are to penetrate the ceiling runner or adiabatic ceiling track.

The head width of the joint system is equal to the width of the wall.

3. Joint System — Max. separation between bottom of floor and top of gypsum board at the line of installation of the joint system is 1/2 in. (13 mm). The joint system is designed to accommodate a min. 20 percent compression or extension from its installed width. The joint system consists of the following:

A. Forming Material* — Min. 1/2 in. (12.5 mm) deep, mineral wool batt insulation cut to a thickness twice larger than the distance between the top of the gypsum board and the bottom of the floor. Slips compressed 50 percent and installed within ceiling runner above top of floor panel flush with the inside surface of the panel. Slips compressed and installed on finished side of the wall between the top of the gypsum board and the bottom of the floor. Slips with the inside surface of the panel, flush with the surface of the wall.

ROCK WOOL MANUFACTURING CO. — Chalk Board

ROCK, INC. — SAFE

THEBAF

AT: Forming Material* — Slips — As an alternate to Item 2A, the slips are slotted to a height twice larger than the distance between the top of the gypsum board and the bottom of the floor. Slips compressed 50 percent and installed within ceiling runner above top of floor panel flush with the inside surface of the panel. Slips compressed and installed on finished side of the wall between the top of the gypsum board and the bottom of the floor. Slips with the inside surface of the panel, flush with the surface of the wall.

H.E.T.I. CONSTRUCTION CHEMICALS, DIV. OF H.E.T.I. INC. — CP 717 Speed Slips

B. "B" Stud or Chalk Headset — Min. 1 in. (25 mm) depth of stud to be installed to fill three gap between top of gypsum board floor panel (Item 2D) and top inside surface of ceiling runner or adiabatic ceiling track prior to installation of gypsum board sheets (Item 2E) on finished side of wall. Min. 1 in. (25 mm) depth of stud to be installed to fill three gap between top of gypsum board sheets (Item 2E) and bottom of concrete floor.

H.E.T.I. CONSTRUCTION CHEMICALS, DIV. OF H.E.T.I. INC. — CP-071 Firestop Spray or CFS-SP VBS Firestop Joint Spray

*Indicates such products shall bear the U.L. or UL Certification Mark for jurisdictions enabling the U.L. or UL Certification (such as Canada), respectively.

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 21, 2015. Page: 2 of 2

System No. HW-D-0572

Reproduced by H.E.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. November 21, 2015. Page: 2 of 2

- Notes:
- Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
 - Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - Minimum and maximum Width of Joints
 - Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
 - If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
 - References:
 - 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 - Intertek Directory of Building Products
 - All governing local and regional building codes

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriters Laboratories Fire Resistance Directory (volume 2).

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____


ISSUE DATE: 06-13-2018

REVISIONS: _____


SHEET NAME: Residential - Flat Deck Joints-Gypsum-Shaft-Walls

SHEET NUMBER: _____

System No. HW-D-0758	
ANSI A207.5	CANULC 5115
Assembly Rating — 1 and 2 hr (See Item 2)	F Rating — 1 and 2 hr (See Item 2)
Normal Joint Width — 1/2 to 3/8 in. (See Item 3)	FT Rating — 1 and 2 hr (See Item 2)
Class I or II Movement Capabilities — 50% Compression or Extension or 80% Compression Only	FN Rating — 1 and 2 hr (See Item 2)
FTN Rating — 1 and 2 hr (See Item 2)	
L Rating at Ambient — Less than 1 CFM/Lin Ft	
Class III Movement Capabilities — 50% Compression or Extension or 80% Compression Only	
L Rating at Ambient — Less than 1.55 L/Lin Ft	
L Rating at 402° F — Less than 1.55 L/Lin Ft	

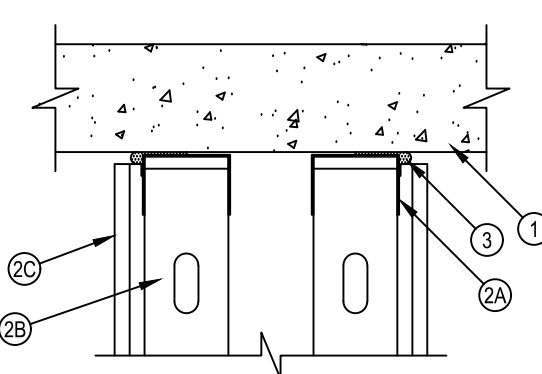

System No. HW-D-0758	
ANSI A207.5	CANULC 5115
Assembly Rating — 1 and 2 hr (See Item 2)	F Rating — 1 and 2 hr (See Item 2)
Normal Joint Width — 1/2 to 3/8 in. (See Item 3)	FT Rating — 1 and 2 hr (See Item 2)
Class I or II Movement Capabilities — 50% Compression or Extension or 80% Compression Only	FN Rating — 1 and 2 hr (See Item 2)
FTN Rating — 1 and 2 hr (See Item 2)	
L Rating at Ambient — Less than 1 CFM/Lin Ft	
Class III Movement Capabilities — 50% Compression or Extension or 80% Compression Only	
L Rating at Ambient — Less than 1.55 L/Lin Ft	
L Rating at 402° F — Less than 1.55 L/Lin Ft	

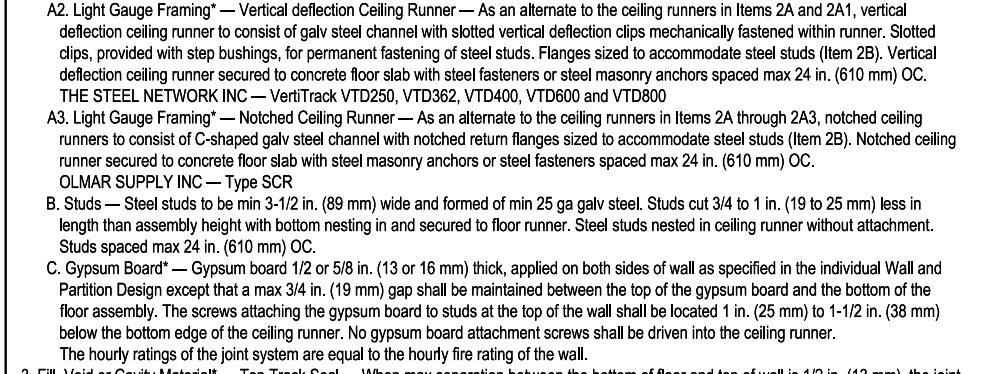

1. Floor Assembly — Min. 4 1/2 in. (114 mm) 1800 reinforced lightweight or normal weight (150-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 18 in. (457 mm) thick, U.C. Classified Moderate Pressure Concrete Unit*.
 See Precast Concrete Unit category in the Fire Resistance Directory for names of manufacturers.
 2. Wall Assembly — The 1 1/2 in. (38 mm) gasket gasket mounted steel studs (steel stud) will assembly shall be substituted of the materials and in the manner described in the individual UACI, VACI or VACI Series Wall and Partition Design in the UL Fire Resistance Directory and shall install by following construction notes.
 A. Steel Floor and Ceiling Runners — Floor and ceiling runners of wall assembly shall consist of min. No. 20 gauge galv-steel channels sized to accommodate steel studs (See 2B). Flange height of ceiling runner shall be min. 1 1/2 in. (38 mm) greater than max. extended joint width.
 Ceiling runner secured to concrete floor slab with steel masonry anchors, steel fasteners spaced 24 in. (610 mm) OC.
 A1. Light Gauge Framing — Bolted Ceiling Runner — As an alternate to the ceiling runner in Item 2A, bolted ceiling runner to consist of galv-steel channel with bolted flanges used to accommodate steel studs (See 2B). Bolted ceiling runner secured to concrete floor slab with steel masonry anchors and steel fasteners spaced max. 24 in. (610 mm) OC.
 BRADY CONSTRUCTION INNOVATIONS INC. CMA SLIPTRACK SYSTEMS — SLP-TRK
 CALPINE SUPPLY INC. — Type S-LT
 MARRONWIRE, DIV. OF WARE INDUSTRIES INC. — Type S-LT
 METALITE INC. — The System
 SCARCO STEEL SYSTEMS/STURMANS CO. — Bolted Track
 TELLING INDUSTRIES L.L.C. — True-Action Deflection Track
 A2. Light Gauge Framing — Vertical Deflection Ceiling Runner — As an alternate to the ceiling runner in Items 2A and 2A1, vertical deflection ceiling runner to consist of galv-steel channel with bolted vertical deflection clips mechanically fastened within runner. Bolted clips provided with steel brackets for permanent fastening of steel studs. Flanges used to accommodate steel studs (See 2B). Vertical deflection ceiling runner secured to concrete floor slab with steel fasteners or steel masonry anchors spaced max. 24 in. (610 mm) OC.
 THE STEEL METWORK INC. — VertTrack VTD50, VTD60, VTD80 and VTD90
 A3. Light Gauge Framing — Bolted Ceiling Runner — As an alternate to the ceiling runner in Items 2A through 2A3, bolted ceiling runner to consist of galv-steel channel with bolted flanges used to accommodate steel studs (See 2B). Bolted ceiling runner secured to concrete floor slab with steel masonry anchors or steel fasteners spaced max. 24 in. (610 mm) OC.
 CALPINE SUPPLY INC. — Type S-LT
 B. Studs — Steel studs to be min. 3 1/2 in. (89 mm) wide and formed of min. 25 ga galv-steel. Studs cut 24 in. (610 mm) less in length than assembly height with bottom flange secured to floor runner. Steel studs secured to ceiling runner without attachment. Studs spaced max. 24 in. (610 mm) OC.
 C. Gypsum Board — Gypsum board 1/2 in. (13 mm) or 5/8 in. (16 mm) thick, applied on both sides of wall as specified in the individual Wall and Partition Design except that a max. 3/4 in. (19 mm) gap shall be maintained between the top of the gypsum board and the bottom of the floor assembly. The screws attaching the gypsum board to steel at the top of the wall shall be spaced 16 in. (407 mm) or 16 in. (407 mm) below the bottom edge of the ceiling runner. No gypsum board attachment screws shall be driven into the ceiling runner.
 The finish surface of the joint system are equal to the finish of the wall.
 3. Fire Void or Cavity Material — Top Track Seal — When max. separation between the bottom of floor and top of wall is 1/2 in. (13 mm), the joint system is designed to accommodate a max. 25 percent compression or extension from its installed width. When max. separation between the bottom of floor and top of wall is 3/4 in. (19 mm), the joint system is designed to accommodate a max. 60% compression only from its installed width. Fasten installed foam seal installed over the ceiling runner. Seal 20 prior to attachment to concrete or concrete floor in accordance with the installation instructions.
 HILTI CONSTRUCTION CHEMICALS, DIV. OF HILTI INC. — CFS-TTS 306, CFS-TTS 800 or CFS-TTS 05
 * Indicates such products shall bear the UL or U.L. Certification Mark for jurisdictions employing the UL or U.L. Certification (such as Canada), respectively.

Notes:

1. Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
2. Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Minimum and maximum Width of Joints
 - * Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
4. References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 - * Intertek Directory of Building Products
 - * All governing local and regional building codes

Current as of November 19, 2017.
 System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriter's Laboratories Fire Resistance Directory (Volume 2.)'
 LABORATORIES FIRE RESISTANCE DIRECTORY (VOLUME 2.)

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 06-13-2018

REVISIONS: _____

SHEET NAME:
 Residential - Flat Deck
 Gypsum-Chase-Walls

SHEET NUMBER: _____

System No. HW-D-0268
Assembly Rating - 3 Hr
Normal Joint Width - 1 in.
L Rating At Ambient - Less Than 1 CFM/Lin Ft
L Rating At 400°F - Less Than 1 CFM/Lin Ft
Class II Movement Capabilities - 12.5% Compression and Extension

1. Floor Assembly - Min 2-1/2 in. (64 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any min. 1 1/2 in. (38 mm) thick, Class II, Classified Intermediate Precast Concrete Unit.
 See Precast Concrete Units (PCU) category in the Fire Resistance Directory for names of manufacturers.
 2. Wall Assembly - Min 8 in. (203 mm) thick cast-in-place lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Wall may also be constructed of any "A, Classified Concrete Blocks".
 See Concrete Blocks (CB) category in the Fire Resistance Directory for names of manufacturers.
 3. Joint System - Min separation between bottom of floor assembly and top of concrete wall at time of installation is 1 in. (25 mm). The joint system is designed to accommodate a min. 12.5 percent compression or extension from its installed width. The joint system shall consist of the following:
 A. "A" "Void or Cavity Material" - Substrat - A 1/2 in. (13 mm) thickness of M material installed within the joint. Bush with each surface of the wall.
 HETI CONSTRUCTION CHEMICALS, DIV OF HETI INC - CP968 Flexible Firestop Sealant
 B. Forming Material - (Optional, Not Shown) - Mineral wool insulation or polyethylene foam backer rod. Forming material to be recessed from both surfaces of the wall as required to accommodate the required thickness of B material.
 HETI CONSTRUCTION CHEMICALS, DIV OF HETI INC - CP968 Flexible Firestop Sealant
 *Bearing the UL Classification Mark

Reproduced by HETI, Inc. Courtesy of Underwriters Laboratories, Inc. June 26, 2018

System No. HW-D-0403
Assembly Rating - 3 Hr
L Rating at Ambient - Less than 1 CFM/Lin Ft
L Rating at 400 F - Less than 1 CFM/Lin Ft
Normal Joint Width - 2 in.
Class II Movement Capabilities - 8% Compression Or Extension

1. Floor Assembly - Min 2-1/2 in. (64 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any min. 1 1/2 in. (38 mm) thick, Class II, Classified Intermediate Precast Concrete Unit.
 See Precast Concrete Units (PCU) category in the Fire Resistance Directory for names of manufacturers.
 2. Wall Assembly - Min 8 in. (203 mm) thick cast-in-place lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Wall may also be constructed of any "A, Classified Concrete Blocks".
 See Concrete Blocks (CB) category in the Fire Resistance Directory for names of manufacturers.
 3. Joint System - Min separation between bottom of floor and top of wall at time of installation of joint system is 2 in. (51 mm). The joint system is designed to accommodate a min. 8 percent compression or extension from its installed width. The joint system shall consist of the following:
 A. Forming Material - Min 1/2 in. (13 mm) mineral wool batt insulation installed in joint opening as a permanent form. Pieces of batt cut to min. width of 1/2 in. (13 mm) and installed edge first into joint opening, parallel with joint direction. Such batt sections are compressed to 50 percent in thickness and such that the compressed batt sections are recessed from both surfaces of the wall as required to accommodate the required thickness of B material. Minimum length of batt to be 1/2 in. (13 mm) with batt ends spaced min 24 in. (610 mm) apart along the length of the joint.
 B. "B" "Void or Cavity Material" - Substrat - Min 1/2 in. (13 mm) thickness of M material applied within the joint. Bush with both surfaces of the wall.
 HETI CONSTRUCTION CHEMICALS, DIV OF HETI INC - CP968 Flexible Firestop Sealant
 *Bearing the UL Classification Mark

Reproduced by HETI, Inc. Courtesy of Underwriters Laboratories, Inc. September 29, 2022

Notes:

1. Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
2. Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 * Minimum and maximum Width of Joints
 * Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
4. References:
 * 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 * Intertek Directory of Building Products
 * All governing local and regional building codes

Current as of November 19, 2017.
 System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current "Underwriter's Laboratories Fire Resistance Directory (volume 2.)"

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 06-13-2018

REVISIONS: _____

SHEET NAME:
 Residential - Flat Deck
 Joints-Concrete or
 Masonry Walls

SHEET NUMBER: _____